Georgia Department of Human Resources

ON-SITE SEWAGE MANAGEMENT SYSTEM INSPECTION REPORT

County Code (2-4)	Construction Permit (5-8)	Case Number (FHA, VA, etc.) (9-20)	Health Dist. (21-22)	Day (23-24)	Month (25-26)	Year (27-28)
109	1276		12	15	12	01

Property Location	Property Owner	County
Knob Creek #11-G 1221 Knob Creek Dr.	Debose-Francis-Dyett Sewage Disposal Contractor: Dale Johnson	Oconee

ALL ITEMS: Blank = Not Applicable; 0 = Unknown *ITEMS: 1 = Yes; 2 = No

SECTION A – GENERAL

1. Type Water Supply: (1) Public, (2) Community, (3) Indiv. — 29
2. Financial Assistance: (1) FHA, (2) VA, (3) Farmers Home, (4) Conventional, (5) Other — 30
3. House Structure: (1) New, (2) Existing < 1 year, (3) Existing > 1 year — 31
4. Sewage Disposal Installation: (1) New, (2) Repair to existing sys. — 32
5. If Repair of Existing System – Years System Installed: (1) < 1 year, (2) 1 – 2, (3) 2 – 3, (4) 3 – 5, (5) 5 – 10, (6) >10 — 33
6. Percolation Rate Min./In.: — 34 35
7. *Is Property Part of a Subdivision: — 36

SECTION B – FACILITY

1. **Type Facility: See Code Below — 37 38
2. Water Usage Determined by: (1) No. Bedrooms, (2) No. Gallons — 39
3. Number Bedrooms or Gallons: — 40 41 42 43

SECTION C – LOT SIZE

1. Lot Depth (Average):
2. Lot Width (Average):
3. Building Line (Feet):

SECTION D – PRIMARY TREATMENT

1. Sewage Disposal Method: (1) Septic Tank, (2) Construction Privy, (3) Pit Privy, (4) Aerobic Unit, (5) Other — 44: 1
2. Septic Tank Capacity (gallons): — 45 46 47 48: 1500
3. Unit 1 Tank/Compartment Capacity: — 49 50 51 52
4. Septic Tank Inside Length (feet):
5. Septic Tank Inside Width (feet):
6. Septic Tank Liquid Depth (feet):
7. Septic Tank Material: (1) Precast concrete, (2) Poured in place, (3) Other — 53
8. Dosing Tank Capacity (gallons): — 54 55 56
9. Grease Trap Capacity (gallons): — 57 58 59
10. Distance Septic Tank from Well:

SECTION E – SECONDARY TREATMENT

1. Field Layout Method: (1) Distribution Box, (2) Level Field, (3) Serial, (4) Mound, (5) Other — 60: 5
2. Absorption Field:
   a. Total Square Feet — 61 62 63 64: 1200

   b. Total Linear Feet: 400
   c. Length each Trench (feet) — 65 66 67 68
   d. Width of Trenches (inches): 36
   e. Number of Trenches — 69 70: 3
   f. Distance between Trenches: 10
   g. Average Trench Depth (inches): 36
   h. * Aggregate Proper Size
   i. * Aggregate Proper Depth
   j. Distance from Building Foundation: 10
   k. Nearest Property Line: (1) Front, (2) Rear, (3) R. Side, (4) L. Side
   l. Distance Nearest Property Line
   m. Distance Privy or Absorption Field from Well

SECTION F – HEALTH AGENCY TIME

1. Total Inclusive Time (min.): 60

SECTION G – SYSTEM APPROVED — 71 72 73

1. * Yes
2. No: 2 — 74

Sketch

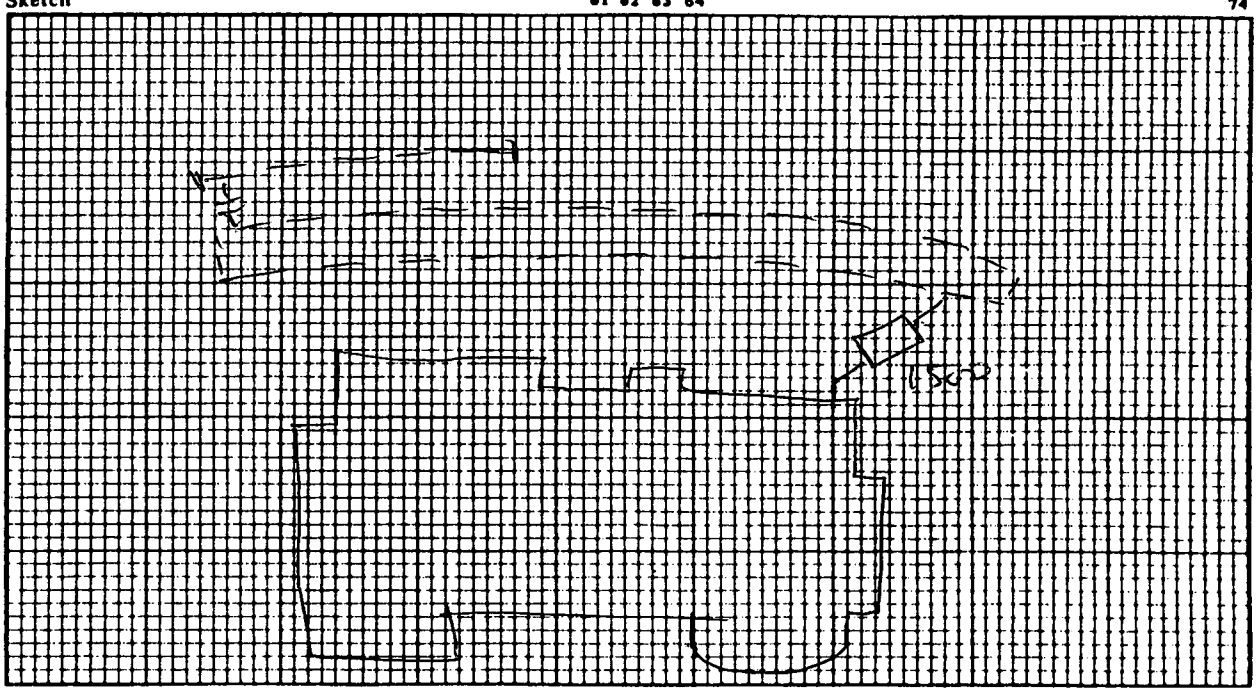

1.**Type Facility
(1) Residence
(2) Apartment
(3) Institution
(4) Service Station
(5) Restaurant
(6) Church
(7) Tourist Accommodation
(8) Launderette
(9) Mobile Home Park
(10) Other
(Specify) _____

Remarks:

Inspected By	Title	Health Agency
[signature]	RHS III	Oconee

Form 3884 (Rev. 5-84)