

JOHNSTON COUNTY ENVIRONMENTAL HEALTH DEPARTMENT

309 E. Market Street
 Smithfield, North Carolina 27577
 Telephone: 919-989-5180 • Fax: 919-989-5190

Application # 92036 Parcel # _____

Name: WALTHAM GROUP Address: 70 CALABRIA CT. CLAYTON

Location: 70 W T/R 42E SUBD. APPROX 5 MI ON (R)

Facility - Type: RESID S/D & Lot # FORTOFINO 86

Soil Site Classification: PS LTAR: 135

Bedrooms: 4 Design Daily Sewage Flow: 480 Lot Area: 1.16

New Construction: X Repair: _____ Upgrade: _____ Water Supply: PUBLIC

Septic Tank Size: 1000 Grease Trap Size: _____

Pump Tank Size: _____ Pump(s) Size: _____

Drainfield Type: CONV. & ACC Square Feet: 1500

of Lines: 5 Width: 3 Length: 100 Depth: 18" - 24"

Design/Layout by: _____ Improvement Permit Issued by: EB Date: 5/18/11 Exp. Date 5/18/14

Inspection: Lines: EB E212034 Septic Tank: EB D-Box: EB

Pump Tank: _____ Pump(s)/Pressure: _____


Drainage: _____ Contractor: AVILLA

AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION

ISSUED BY: [Signature] DATE ISSUED: 5/18/11

By rule, this septic system requires the use of an effluent filter and a waterproof seal. A riser and septic marker may also be required. Systems shall be installed as shown in sketch or according to attached plans and specifications. Any unauthorized site disturbance, filling, soil removal, or layout changes may result in the permit being revoked. Improvement permit is valid for 5 years from date of issuance unless otherwise indicated. The owner/agent accepts & verifies the conditions of the permit as indicated below.

OWNER/AGENT: _____ DATE: _____

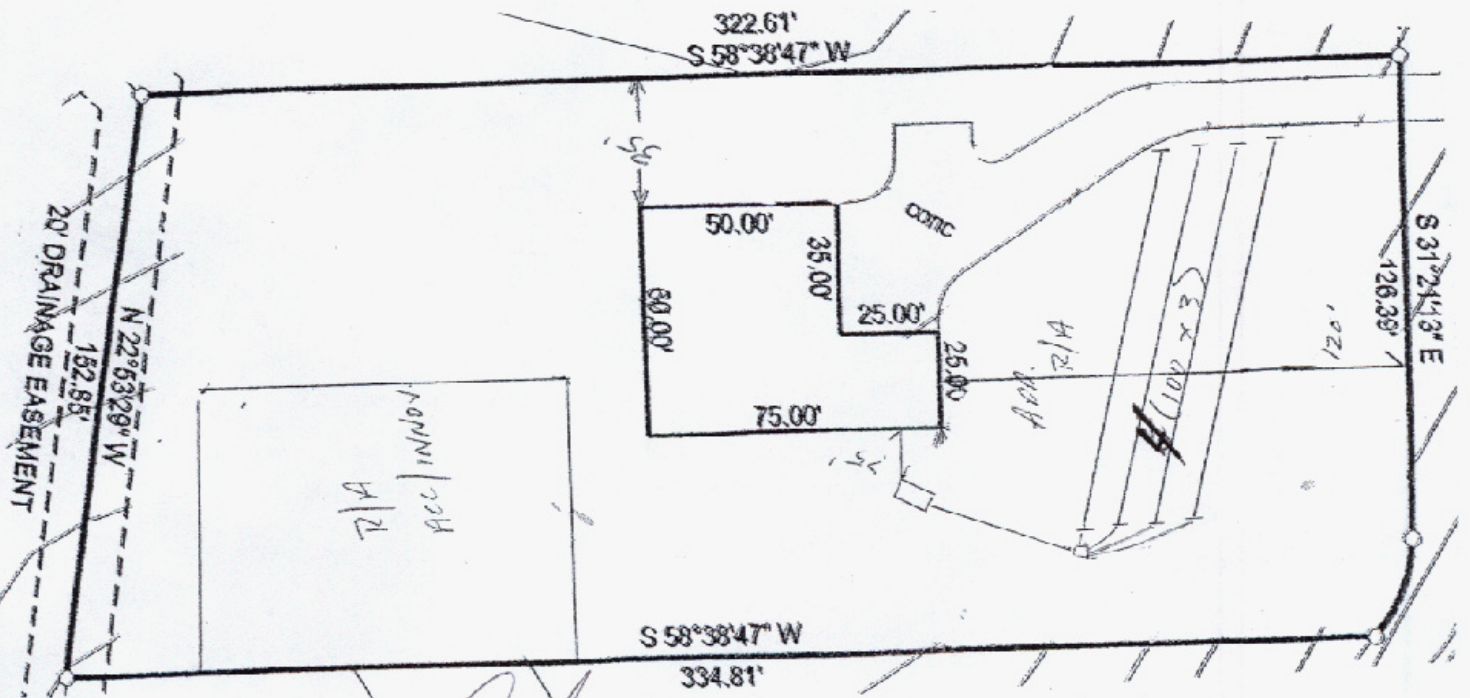

OPERATION PERMIT BY: [Signature] DATE: 4/18/12